


30min Intermediate Floor Detail

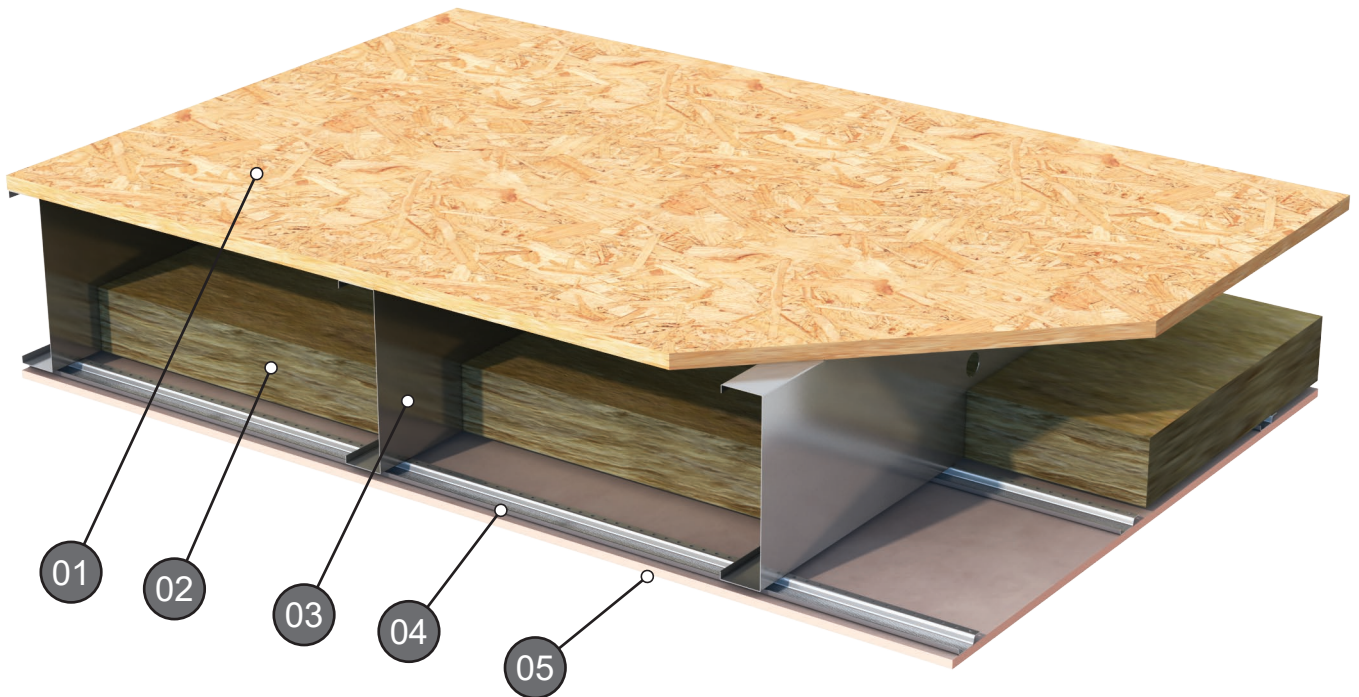

- 01.** 22mm OSB3 decking boards.
- 02.** Stone mineral wool insulation.
- 03.** LGS C-Section floor joists.
- 04.** Resilient Bars.
- 05.** 12.5mm Type F plasterboard to provide R 30 REI 15 in accordance with table 4 fire performance requirements.

Note: All services penetrations in intermediate floor must be fully fire stopped to maintain R 30 REI 15 fire protection.