


External Wall Corner Junction

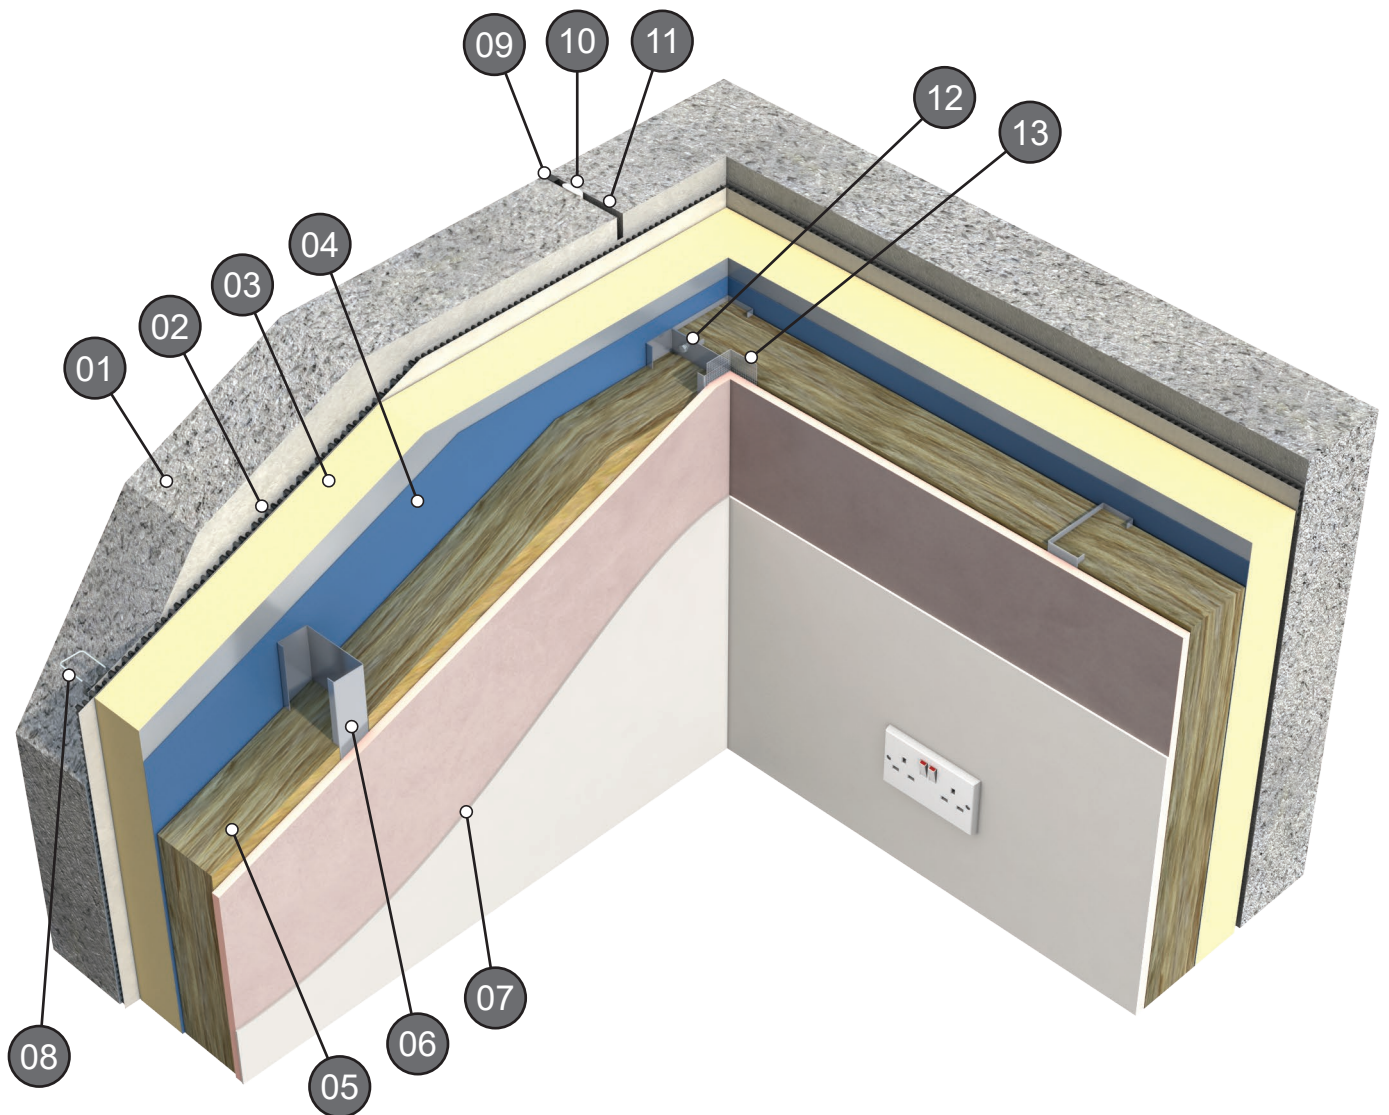

01. Precast concrete wall or other NSAI approved cladding system.

02. Residual cavity.

03. PIR Insulation.

04. Selected AVCL.

05. Stone mineral wool insulation.

06. LGS metal stud.

07. 12.5mm Type F Plasterboard to provide REI 30 External wall in accordance with table 4 fire performance requirements.

08. Thermal anchor.

09. Mastic sealant.

10. Backing rod.

11. Vertical joint.

12. Screw fixing.

13. Perimeter angle or corner stud.