


Party Wall Junction Detail (Interior view)

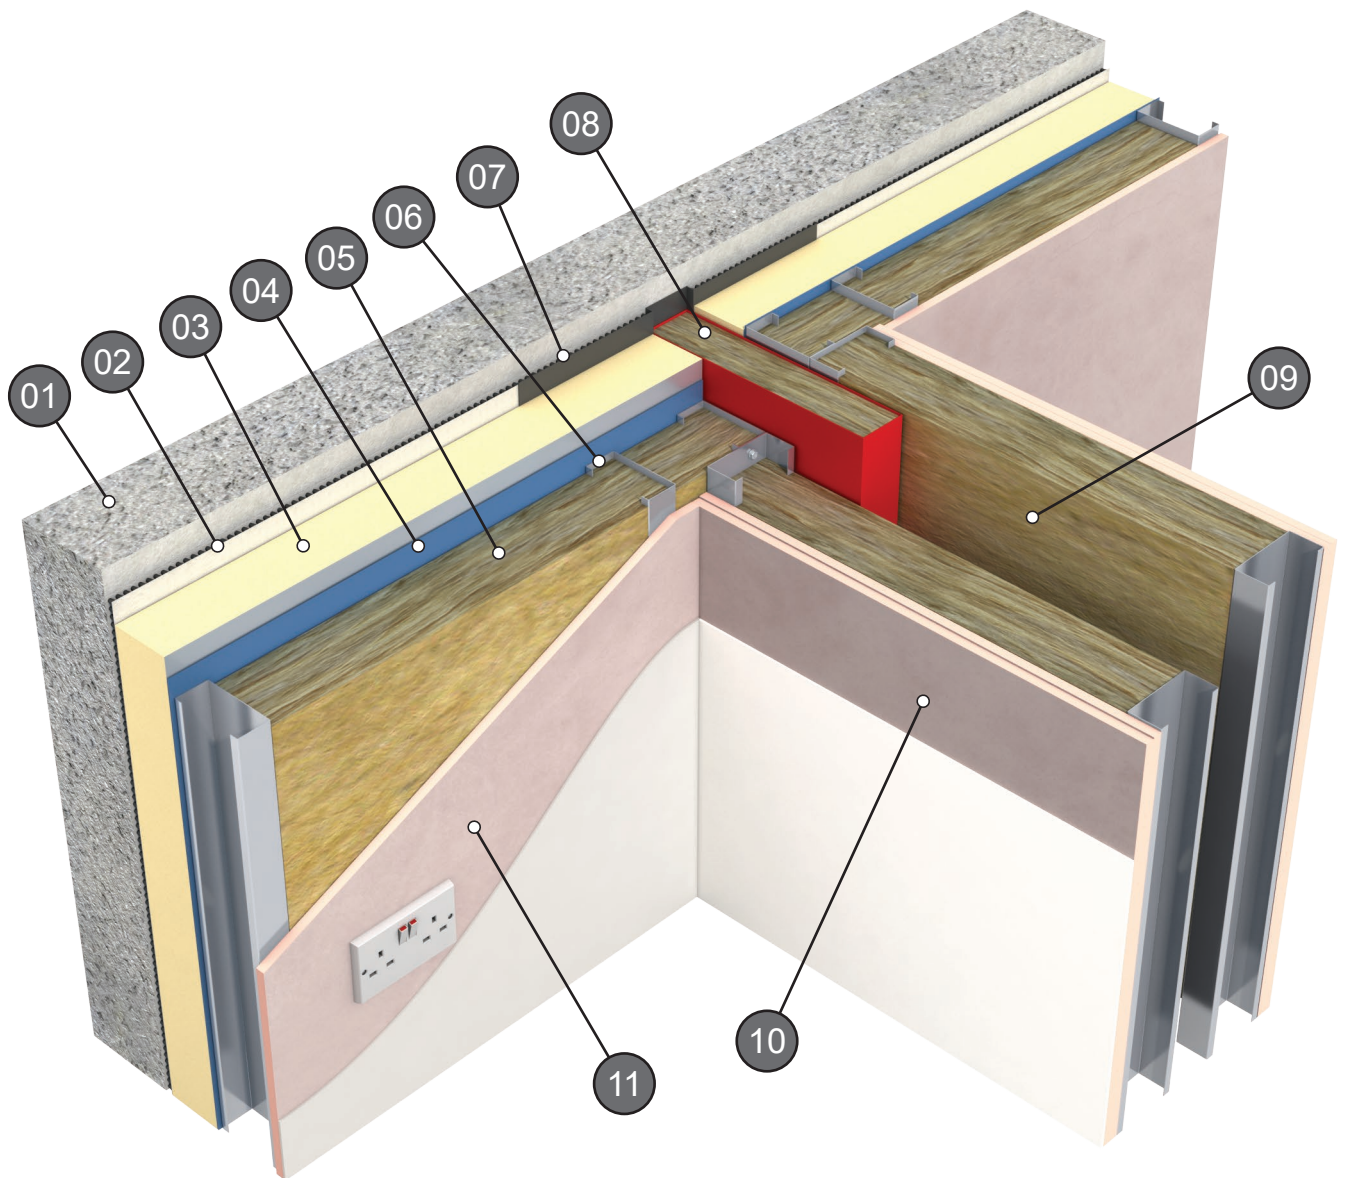

01. Precast concrete wall or other NSAI approved render.

02. Residual cavity.

03. PIR Insulation.

04. Selected AVCL as required.

05. Stone mineral wool insulation.

06. LGS metal stud.

07. DPC.

08. Selected firestop at perimeter wall junction.

09. Stone mineral wool insulation.

10. 2 no. layers of 15mm Type F Plasterboard to provide REI 60 Separating wall in accordance with table 4 fire performance requirements.

11. 1 No layer of 12.5mm Type F Plasterboard to provide REI 30 External wall in accordance with table 4 fire performance