


Window Reveal Detail

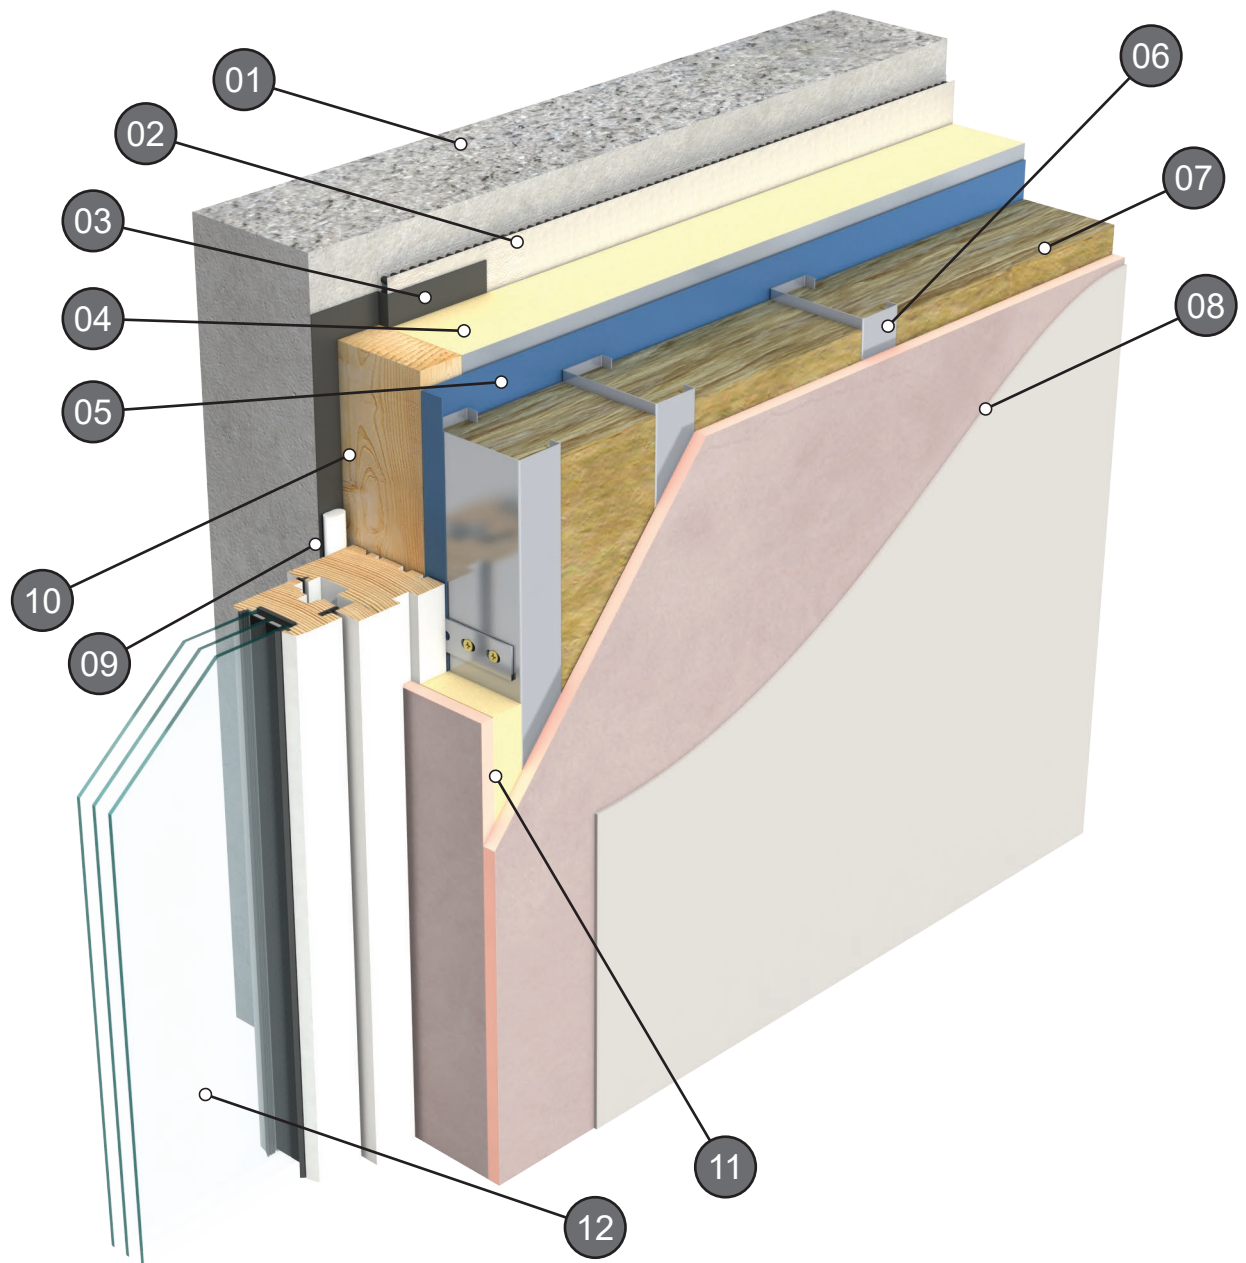

01. Precast concrete wall or other NSAI approved render.

02. Residual cavity.

03. DPC

04. PIR Insulation.

05. Selected AVCL.

06. LGS metal stud.

07. Stone mineral wool insulation.

08. 1 no layer of 12.5mm Type F Plasterboard to provide REI 30 External Wall in accordance with table 4 fire performance requirements.

09. Selected Sealant.

10. Treated timber batten.

11. Insulation backed plasterboard.

12. Selected window.