


Window Sill Detail

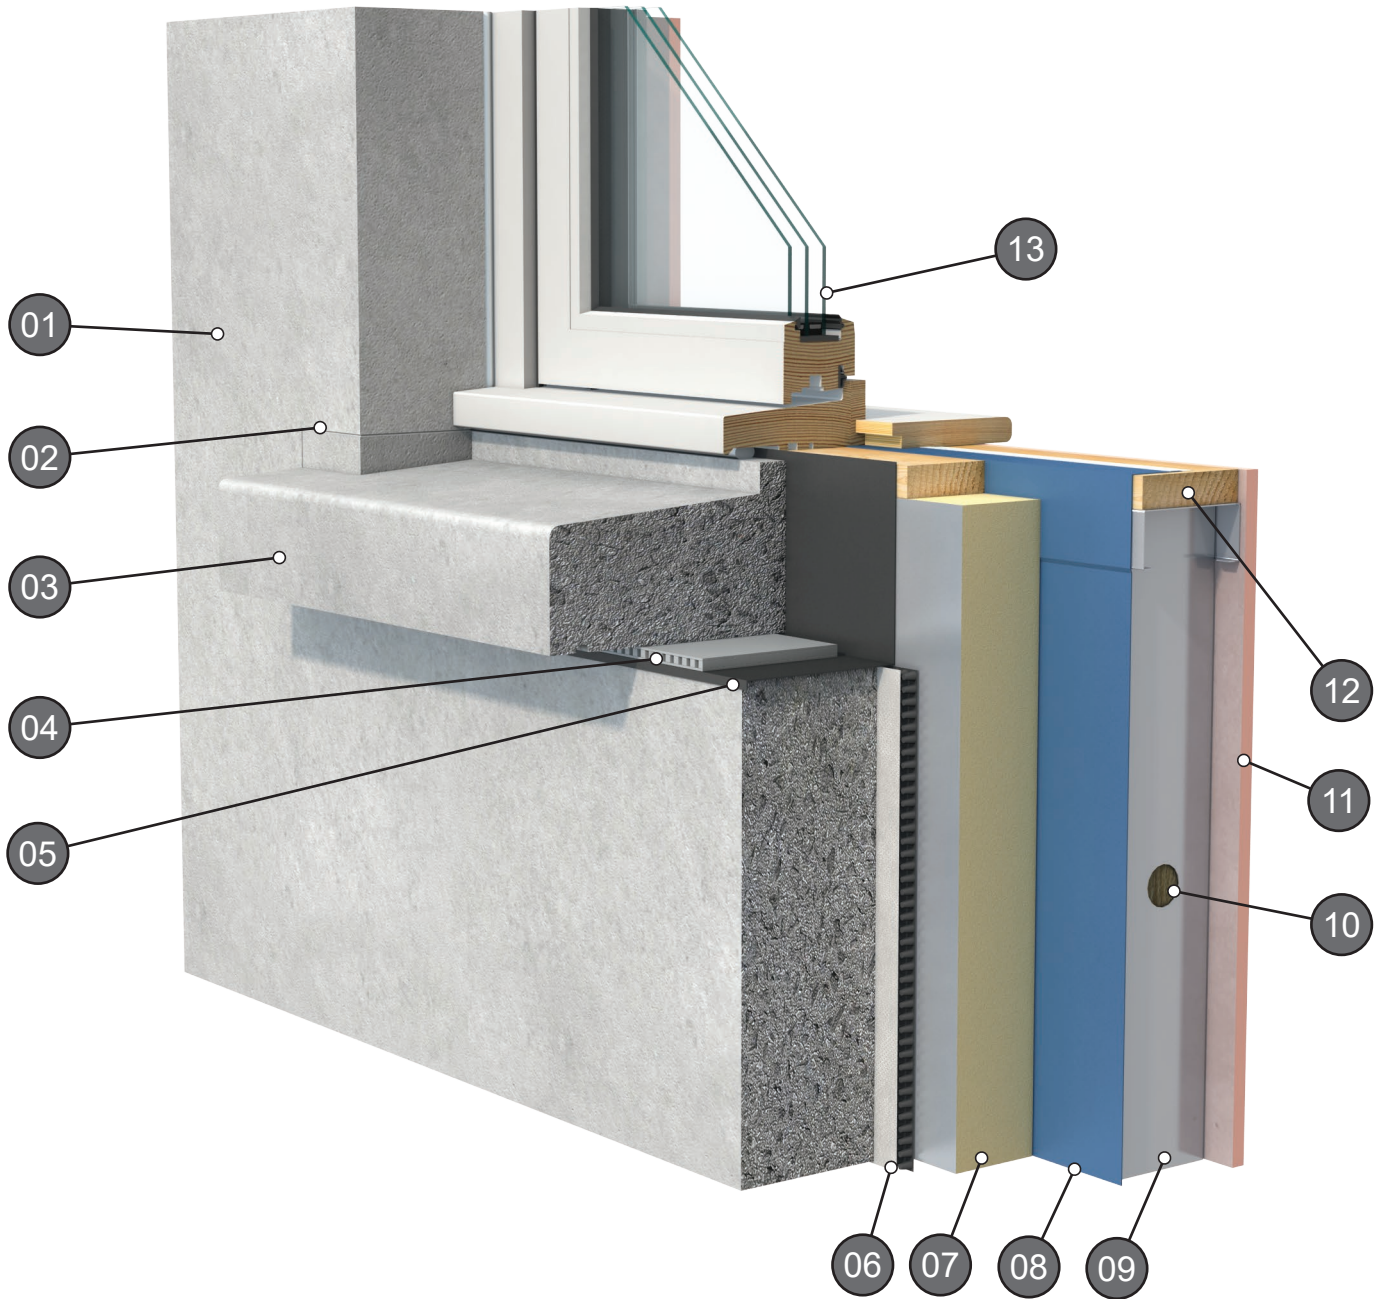

01. Precast concrete wall or other NSAI approved render.

02. Movement joint.

03. Stooled sill.

04. Weep vent.

05. DPC tray.

06. Residual cavity.

07. PIR Insulation.

08. Selected AVCL.

09. LGS metal stud.

10. Stone mineral wool insulation.

11. 1 no layer of 12.5mm Type F Plasterboard to provide REI 30 External Wall in accordance with table 4 fire performance requirements.

12. Treated timber batten.

13. Selected window.